


W.C.E.C.

Clearances*

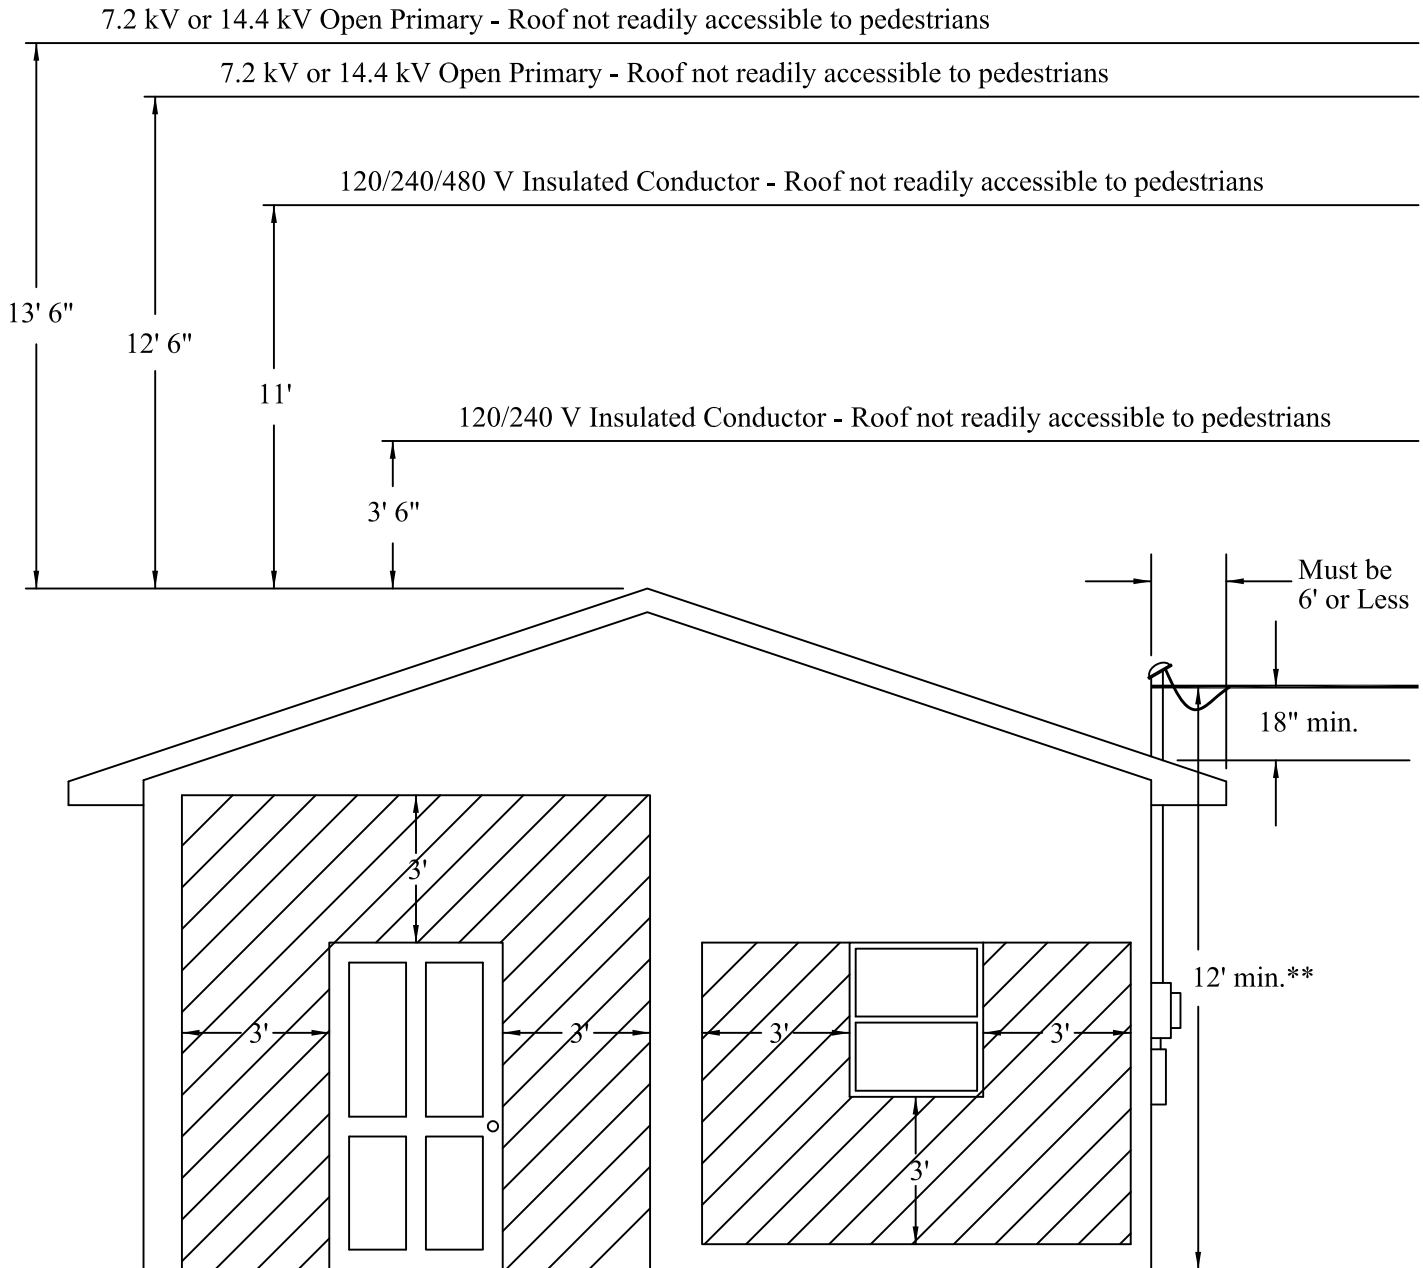

Notes:

1. Through roof mast must be of rigid conduit and of adequate strength or be supported by braces or guys - 2" is minimum conduit size.
2. Point of attachment may NOT be made within hatched areas.
3. Applicable City Wiring Requirements must be utilized where applicable, otherwise follow the requirements on this sheet and those in the National Electrical Code.

* 2017 NESC

** Point of attachment must be 12' (if \leq 300 volts to ground and not subject to truck traffic).

Notice:

Members may be charged a "Trip Fee" for additional trips due to errors in the member's wiring.

Wharton County Electric Coop., Inc.
Engineering Department
P.O. Box 31, El Campo, TX 77437
Ph. (979) 543-6271
Dwn. by: BLL Date: 05/02/17
Approved by: W.L. E12F_E128